




FICHE TECHNIQUE PRODUIT

PRECORBIN

Granulat : **Tout venant 0/80**
 Période : **SEPTEMBRE 2025**
 Nombre de prélèvement: : **2**

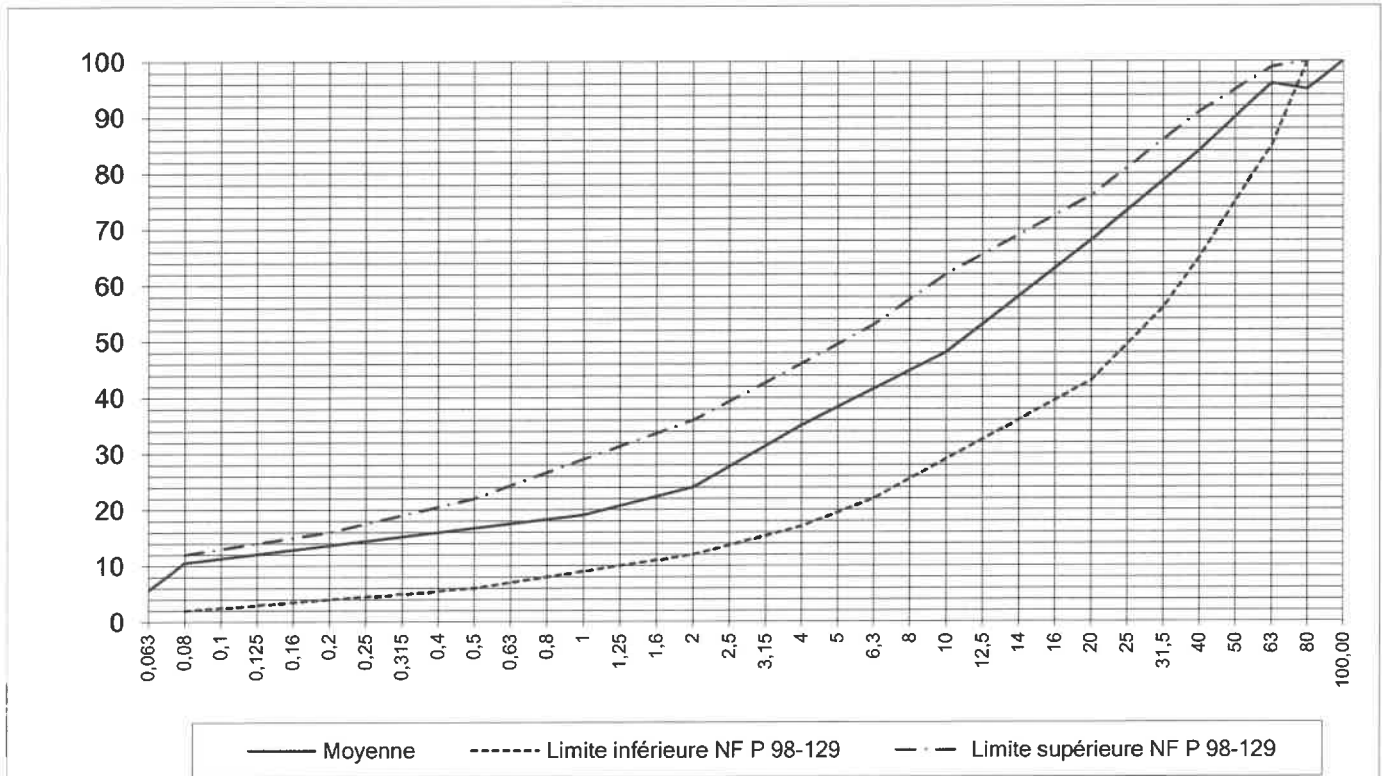

TAMIS	0,063	0,080	1,0	2	4	10,0	20	40	63,0	80	100
Fuseau de spécification		12,0		36,0	46,0	62,0	76,0	91,0	99,0	100,0	100,0
		2,0		12,0	17,0	29,0	43,0	65,0	85,0	100,0	85,0
Moyenne	6,0	10,5	19,0	24,0	35,0	48,0	68,0	84,0	96,0	95,0	100,0

	Résultat moyen	Valeur maxi.	Valeur mini.	Spécification
Micro-Deval en présence d'eau	NF EN 1097-1	fraction : 10/14 MDE = 36	45	<=
Los Angeles	NF EN 1097-2	fraction : 10/14 LA = 32 VBS = 0,08	45 0,1	<=
		Te		